



COPYRIGHT © 2009 EMCON  
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

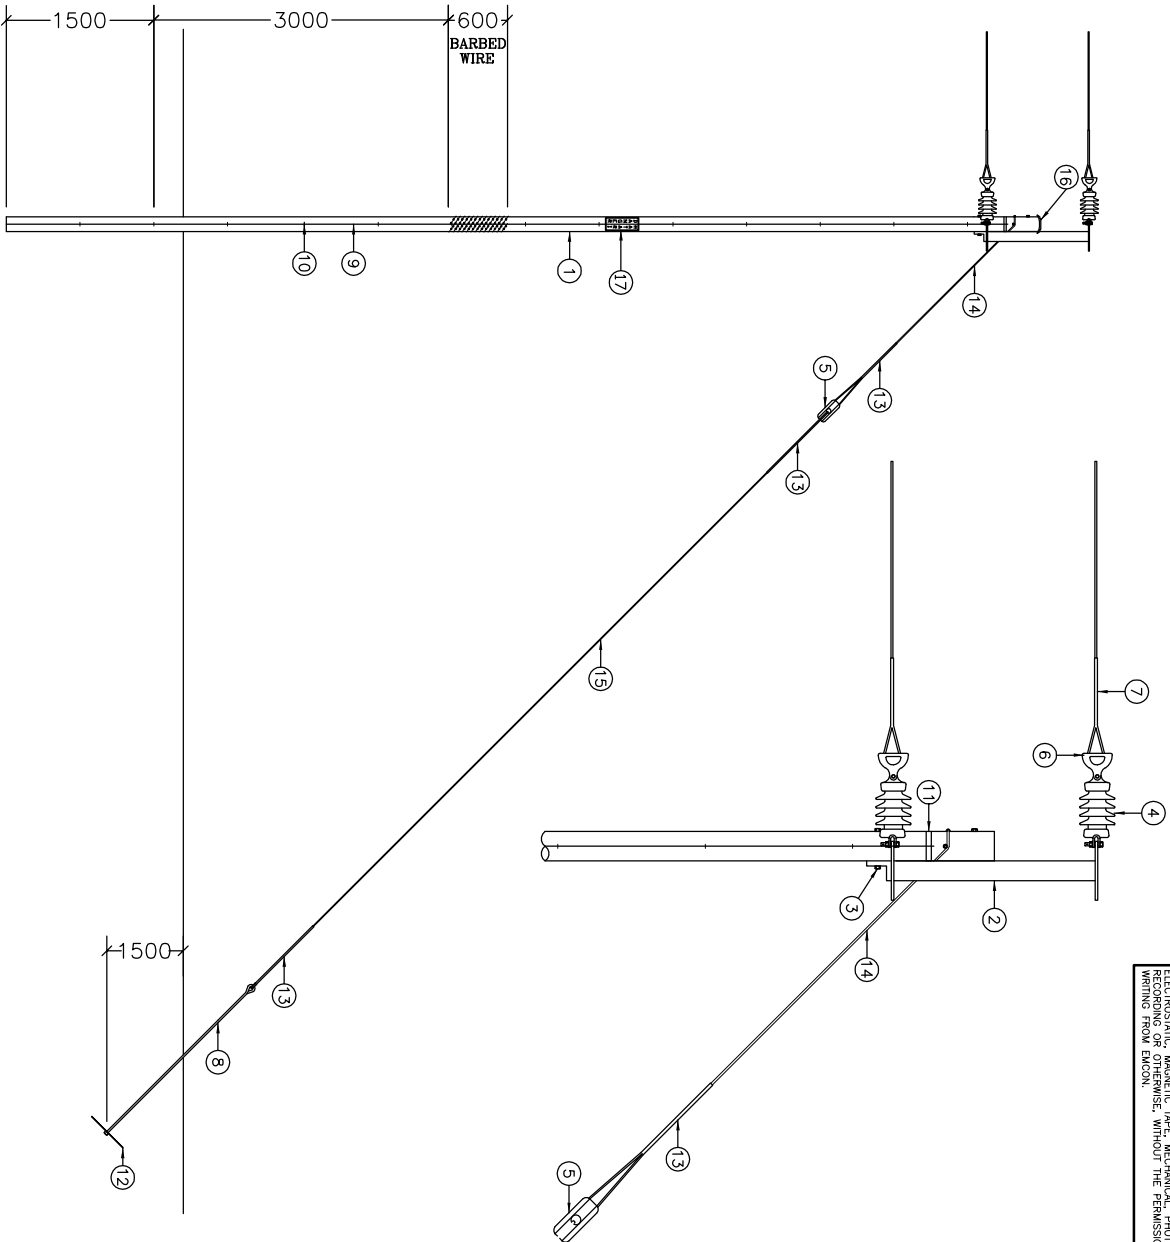

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	1	11m LONG TOP 160mm $\phi$
2	STRAIN A-FRAME	1	SEE DWG NO. STD-WAF-11
3	BOLTS & WOOD POLE WASHERS	3	M12x250mm COMPLETE
4	LONGROD INSULATOR	3	CULLINAN, EP 1044, 1200 CREEPPAG
5	STAY INSULATOR	1	CULLINAN, 21-0522
6	THIMBLE CLEVIS	3	PLP, MTC 70
7	DEAD END	3	PLP, ADE 280
8	STAY ROD	1	B520 C/W THIMBLE, M20x2000
9	POLE EARTH CONDUCTOR	11	3/4.00mm HOT DIP GALVANISED
10	STAPLES	30	3x32mm HOT DIP GALVANISED
11	BAND-IT STRAPPING	1	20x0.7mm STAINLESS STEEL
12	BASE PLATE	1	350x350x6mm GALVANISED
13	GUY GRIP	3	PLP GSDE 472
14	POLE TOP MAKE OFF	1	PLP PT 472
15	STAY WIRE GALVANISED	15	5/4 STAYWIRE GALVANISED
16	POLE CAP		
17	DANGER PLATE		

**NOTES:**  
 1. STRAIN A-FRAME AND POLE TOP MAKE OFF MUST BE PROPERLY CONNECTED TO EARTH.

### ELECTRICITY CONTROL BOARD



Box 2923  
 Windhoek  
 NAMIBIA

Tel: (061) 374300  
 Fax: (061) 374305

#### DRAWING TITLE

**MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION  
 END POLE STRUCTURE**

**DESIGNED:** A.K

**DRAWN:** J.W.S

**REV:** 01-2001

**DRAWING No:** STD-MVAF-33KV-04

**SCALE:** N.T.S



ERROR: syntaxerror  
OFFENDING COMMAND: --nostringval--

STACK:

/Title  
( )  
/Subject  
(D:20100127142530+02'00')  
/ModDate  
( )  
/Keywords  
(PDFCreator Version 0.9.5)  
/Creator  
(D:20100127142530+02'00')  
/CreationDate  
(johnny)  
/Author  
-mark-