



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

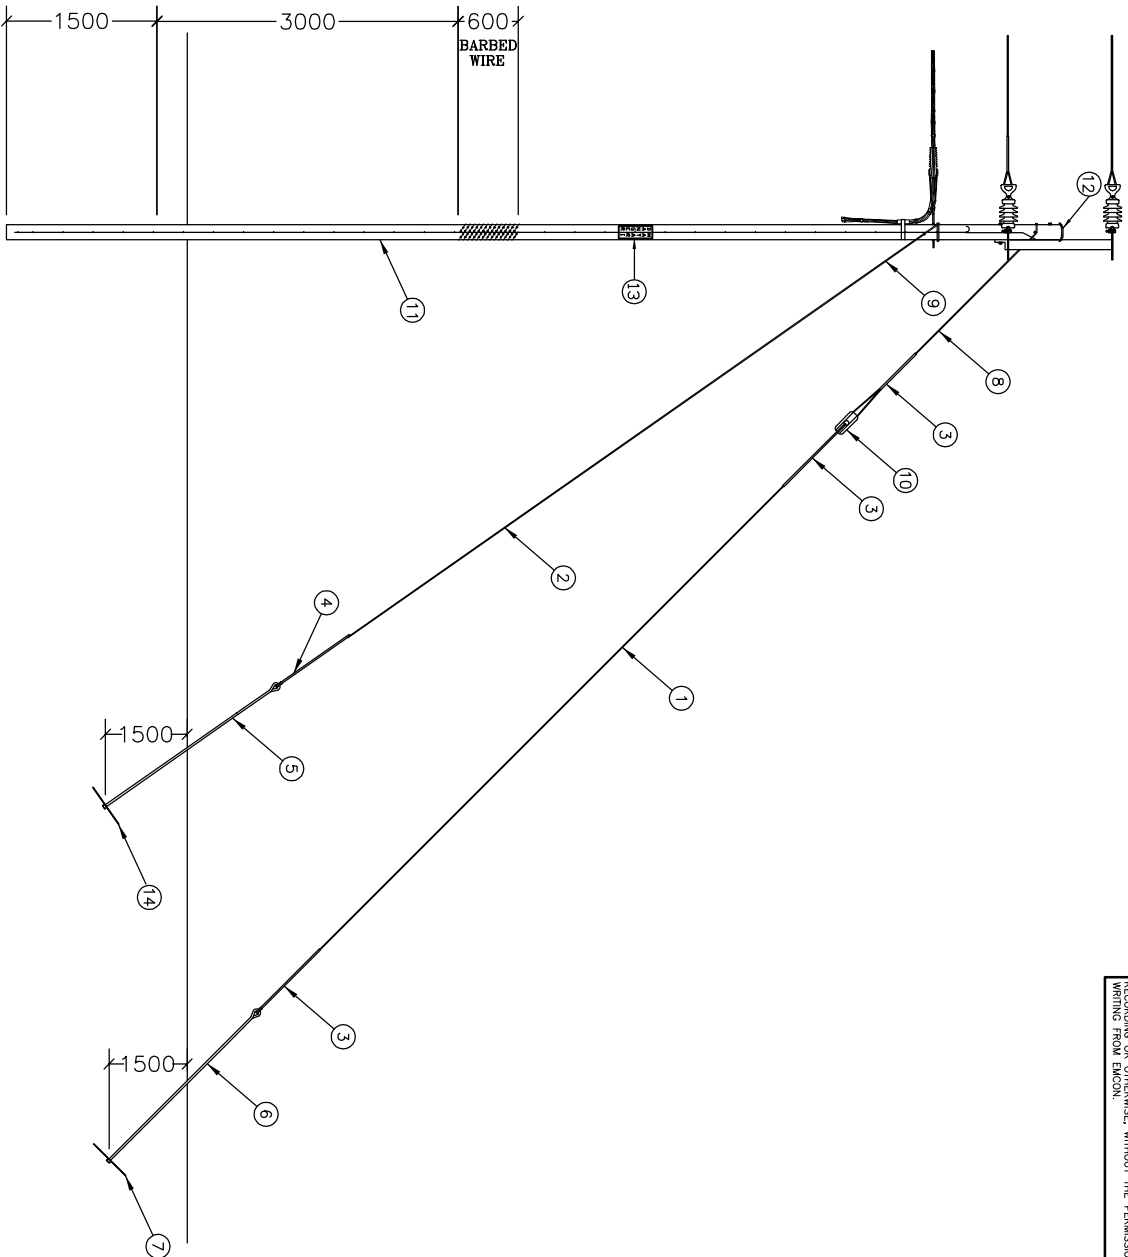

| ITEM | DESCRIPTION | QTY | REMARKS |
|------|------------------------|-----|-----------------------------|
| 1 | STAY WIRE MV | 15m | S/4 GALVANISED |
| 2 | STAY WIRE LV | 15m | S/4.00 GALVANISED |
| 3 | GUYP GRIP MV | 3 | PLP - GSDE 472 |
| 4 | GUYP GRIP LV | 3 | PLP - GSDE 345 |
| 5 | STAYROD LV C/W THIMBLE | 1 | CULLINAN B57 12x1500mm |
| 6 | STAYROD MV C/W THIMBLE | 1 | CULLINAN B57 20x2000mm |
| 7 | BASE PLATE | 1 | 350x350x6mm |
| 8 | POLE TOP MAKE OFF MV | 1 | PLP - PT - 472-6 |
| 9 | DOUBLE WRAP GUYP GRIP | 1 | DMGS 432 |
| 10 | STAY INSULATOR | 2 | CULLINAN, 21-0522 |
| 11 | WOODEN POLE | 1 | 11/12m LONG WITH 160mmØ TOP |
| 12 | POLE CAP | | |
| 13 | POLE CAP | | |
| 14 | BASE PLATE | 1 | 300x300x6mm |

- NOTES:**
1. LV NEUTRAL IS NOT CONNECTED TO POLE EARTH
 2. THE A-FRAME MUST BE EARTHED.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA

Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE

**MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION
 COMBINED MV & LV END POLE STRUCTURE**

| | | |
|--------------------------------------|---------------------|---------------------|
| DESIGNED: A/K | DRAWN: J.W.S | REV: 01-2001 |
| DRAWING No: STD-MVA/F-33KVA08 | | SCALE: N.T.S |

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127142012+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127142012+02'00')
/CreationDate
(johnny)
/Author
-mark-