



COPYRIGHT © 2009 EMCON  
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

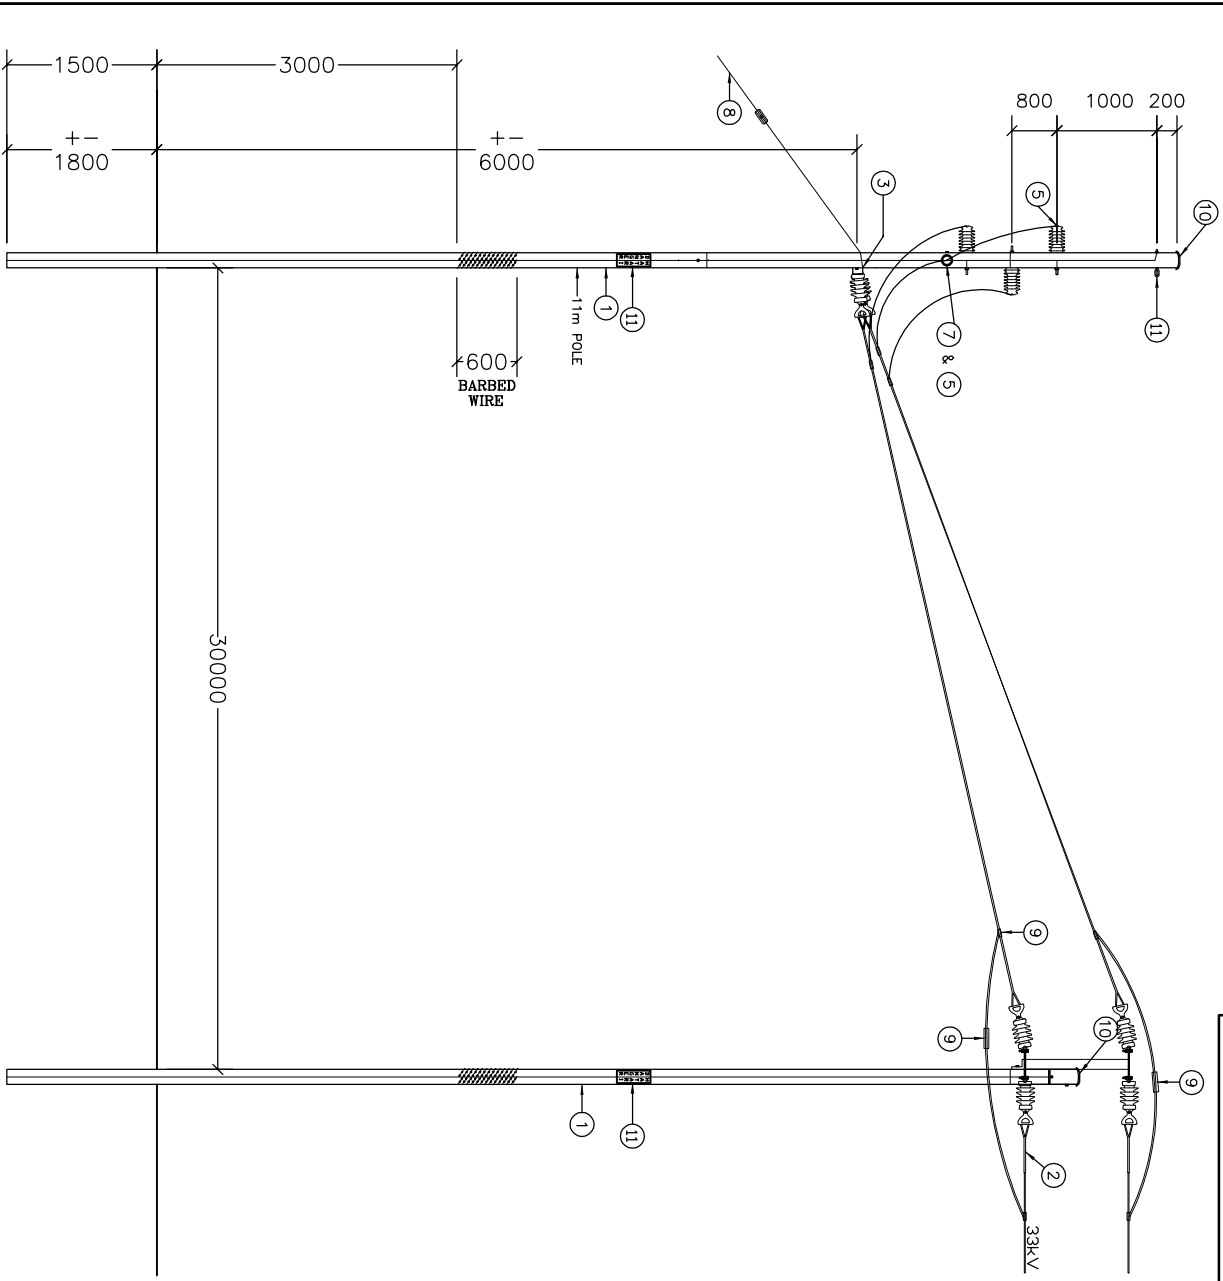

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN POLE	2	13m LONG TOP 160mm <sup>2</sup>
2	LONGROD INSULATOR	9	CULLINAN EP 1044, 1200 CREEPAGE
3	CROSS-ARM	2	SEE DWG NO. STD-MWF-13
4	GOPHER JUMPERS	9x1.5m	GOPHER ALUMINIUM CONDUCTOR
5	LINEPOST INSULATOR	5	CULLINAN EP802, 1100 CREEPAGE
6	OMITTED		
7	SIDE TIES	5	GST 270-280
8	MW STAY ASSEMBLY	12	SEE DWG NO. STD-MWF-04
9	PG CLAMP		
10	POLE CAP		
11	ANGER PLATE		
12	WZO EYE BOLT FOR OPGW		

- NOTES:**
1. ALL JUMPERS SHALL BE GOPHER BARE ALUMINIUM CONDUCTOR.
  2. 13m WOODEN POLES SHALL BE USED FOR A T-OFF ACROSS A ROAD.
  3. ALUMINIUM OXIDE GREASE SHALL BE USED ON ALL CLAMPS FOR CORROSION PROTECTION.
  4. THE CROSS-ARM SHALL BE EARTHED.

**ELECTRICITY CONTROL BOARD**



Box 2923  
 Windhoek  
 NAMIBIA  
 Tel: (061) 374300  
 Fax: (061) 374305

**DRAWING TITLE**  
 MEDIUM VOLTAGE BARE OVERHEAD DISTRIBUTION  
 T-OFF STRUCTURE FOR STAGGERED DETLA  
 CONFIGURATION  
 TO VILLAGES

<b>DESIGNED:</b> A/K	<b>DRAWN:</b> J.W.S	<b>REV:</b> 01-2001
<b>DRAWING No:</b> STD-MVA-F-33KV-19		<b>SCALE:</b> N.T.S



ERROR: syntaxerror  
OFFENDING COMMAND: --nostringval--

STACK:

/Title  
( )  
/Subject  
(D:20100127125222+02'00')  
/ModDate  
( )  
/Keywords  
(PDFCreator Version 0.9.5)  
/Creator  
(D:20100127125222+02'00')  
/CreationDate  
(johnny)  
/Author  
-mark-