


Annex B2- Internal Pole Inspection and Treatment for Class 3 and 4 poles (for rural poles 10m and longer) (Normative)

To be used in conjunction with the text of this specification

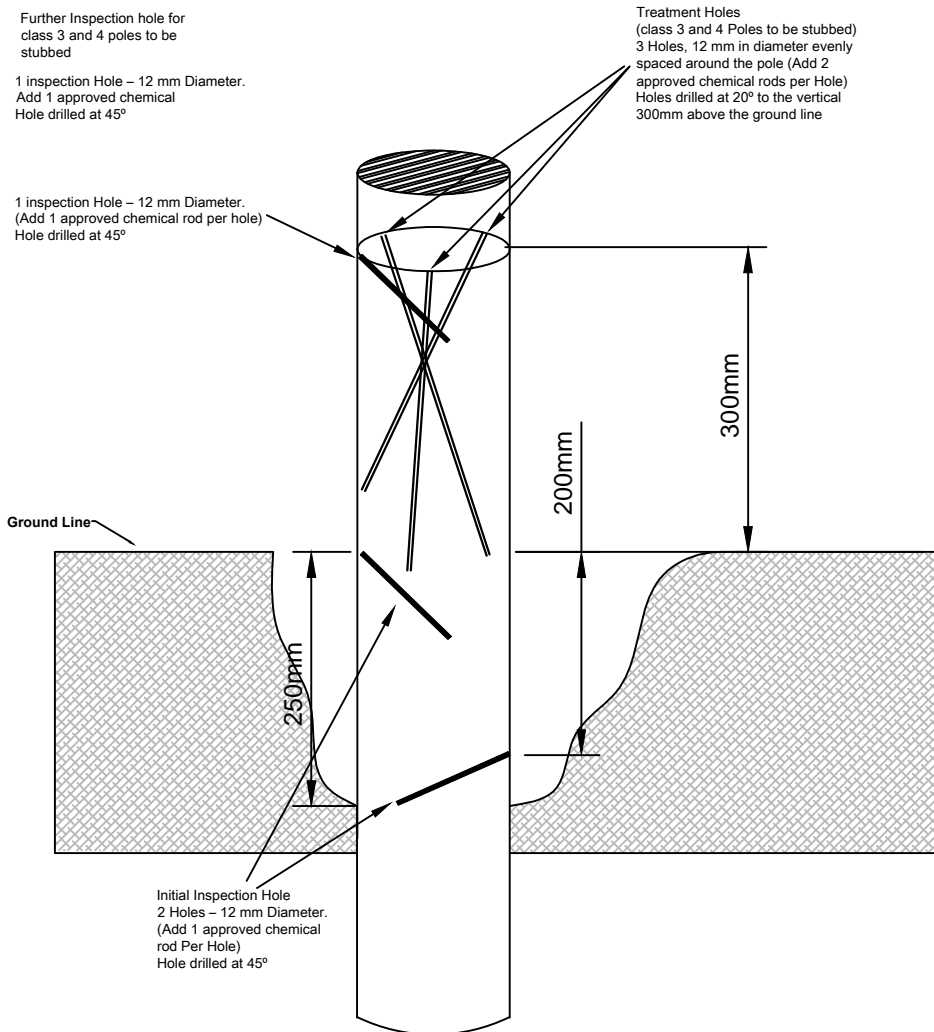

Notes:

- 1) All poles to be excavated and inspected as indicated in this annex. See 2.2.5 and 2.2.7 for more detail.
- 2) Class 3 and 4 poles to be stubbed to have an approved chemical applied internally, See 2.3.2.3 for more detail.
- 3) Where shell rot is present, an approved external chemical is to be applied. See 2.2.6 and 2.3.2 for more details.
- 4) All inspection and treatment holes to be plugged with a removable plastic dowel plug.