


COPYRIGHT © 2009 EMCON  
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

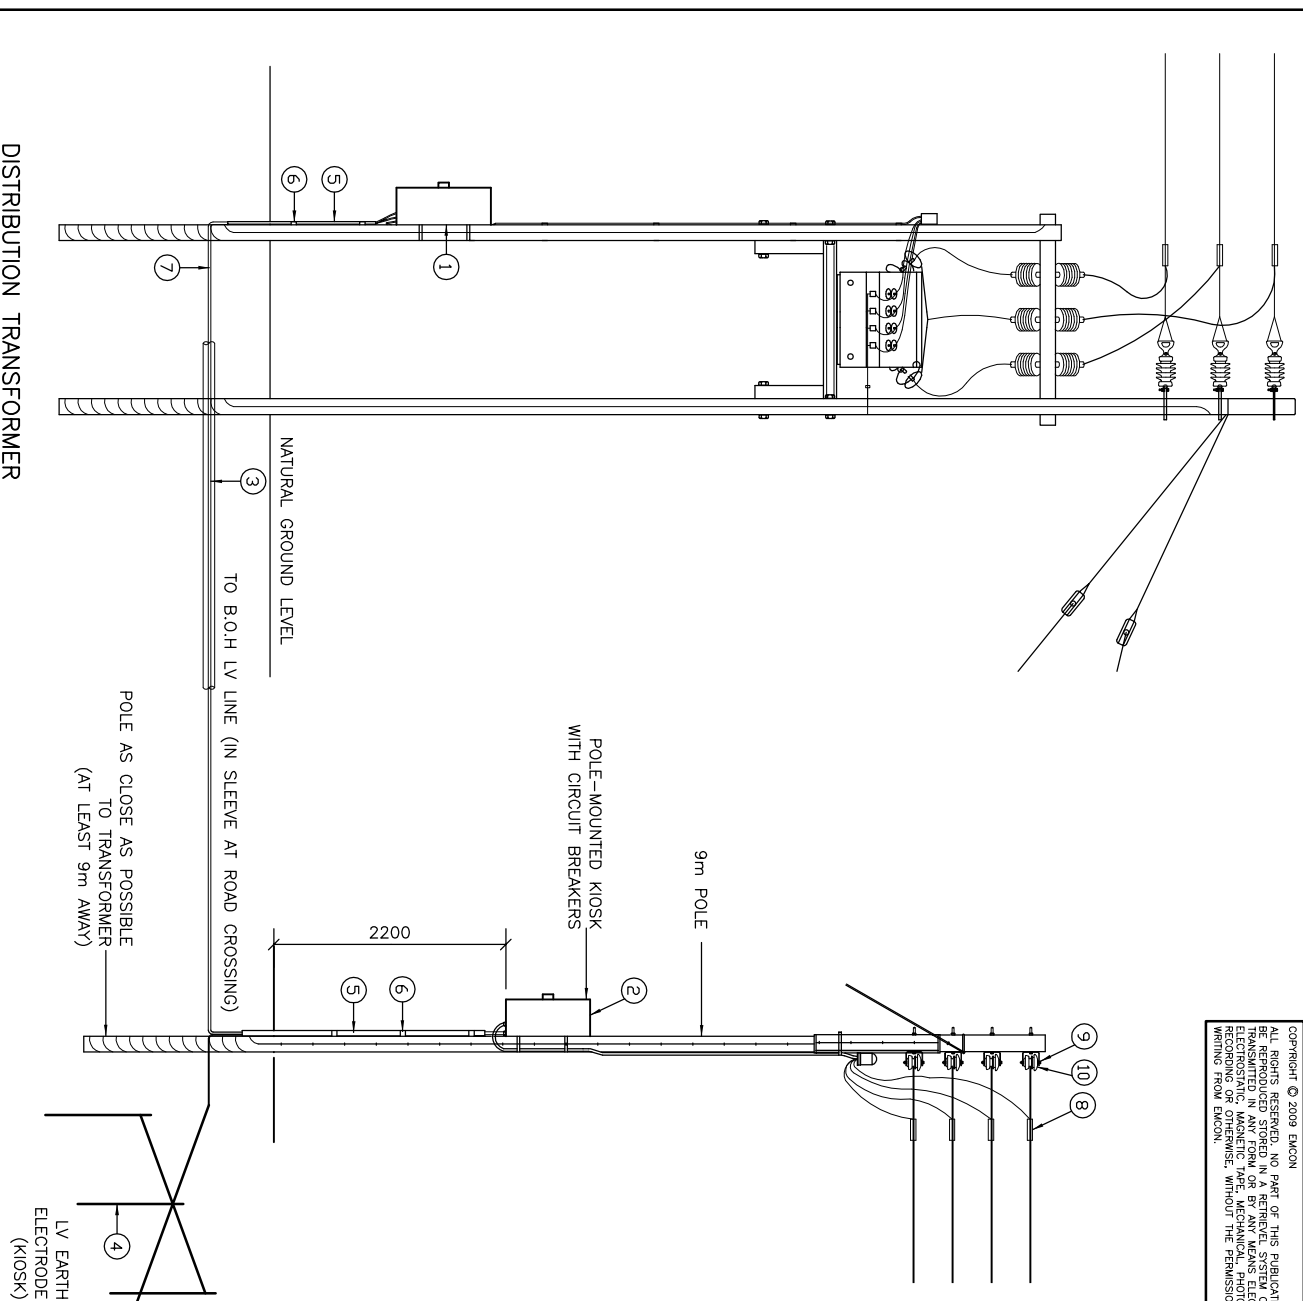

ITEM	DESCRIPTION	QTY	REMARKS
1	POLE MOUNTED METER BOARD	1	SEE DWG. STD-LVBOH-20
2	POLE MOUNTED KIOSK	1	SIZE AS SPECIFIED
3	SUPPLY TO CONSUMER	4	1,2m LONG, 16mm $\phi$
4	EARTH SPIKE	1,4m	50mm $\phi$ HDPE
5	KICK PIPE	2	
6	GALV. SADDLES	14m	70mm $^2$ BARE Cu CONDUCTOR
7	KIOSK EARTH CONDUCTOR	4	
8	Pc CLAMP	4	
9	KIOSK EARTH CONDUCTOR	4	
10	PORCELAIN SHACKLE INSULATOR	4	

**NOTES:**  
 1. LV EARTHING CONDUCTOR OF KIOSK TO BE INSTALLED IN TRENCH FOR 1m AND TERMINATED AT A THREE-POINT STAR EARTH.

**ELECTRICITY CONTROL BOARD**

ELECTRICITY CONTROL BOARD  
 NAMIBIA

Box 2923  
 Windhoek  
 NAMIBIA  
 Tel: (061) 374300  
 Fax: (061) 374305

**LOW VOLTAGE BARE OVERHEAD CONDUCTOR DISTRIBUTION, DISTRIBUTION KIOSK CONNECTION – VILLAGE INTERNAL NETWORK –**

**DRAWING No: STD-LVBOH-02**

<b>DESIGNED:</b> A.K	<b>DRAWN:</b> J.W.S	<b>REV:</b> 01-2001
<b>SCALE:</b> N.T.S		



ERROR: syntaxerror  
OFFENDING COMMAND: --nostringval--

STACK:

/Title  
( )  
/Subject  
(D:20100127095025+02'00')  
/ModDate  
( )  
/Keywords  
(PDFCreator Version 0.9.5)  
/Creator  
(D:20100127095025+02'00')  
/CreationDate  
(johnny)  
/Author  
-mark-