



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

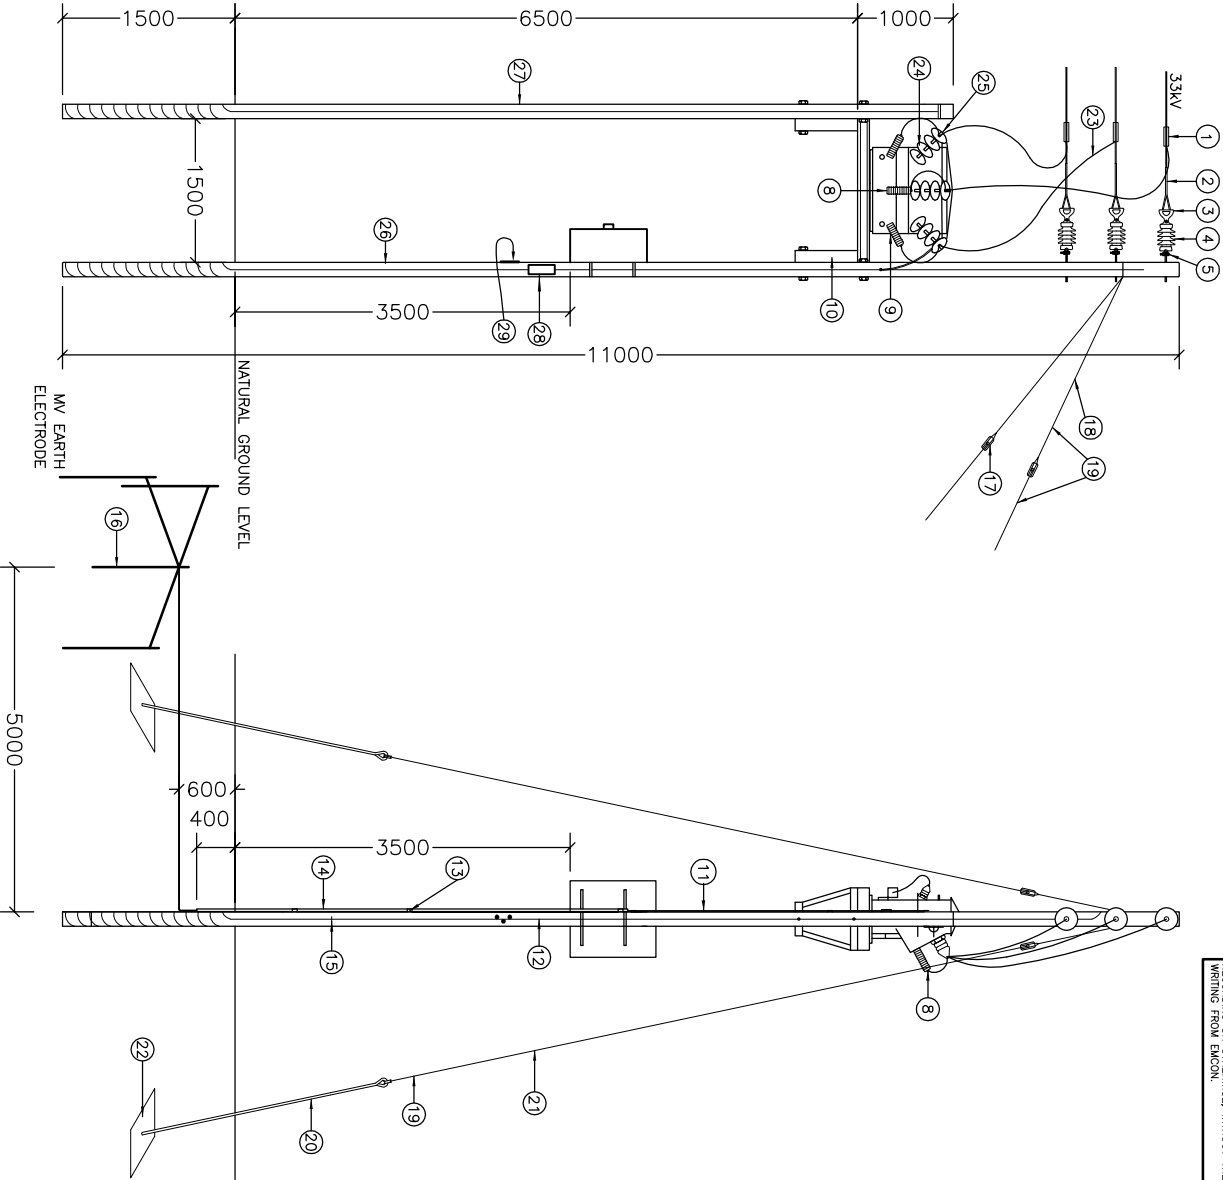

| ITEM | DESCRIPTION | QTY | REMARKS |
|------|----------------------|------|--|
| 1 | FIG. CLAMP | 3 | |
| 2 | DEAD END | 3 | |
| 3 | THIMBLE CLEVIS | 3 | |
| 4 | LONGROD INSULATOR | 3 | EP 1044, 1200mm CREEPAGE |
| 5 | PIN | 3 | GALVANISED MILD STEEL |
| 8 | SURGE ARRESTOR | 3 | RATING AS SPECIFIED |
| 9 | TRANSFORMER GRADLE | 1 | SEE DWG NO. STD-MVF-10 |
| 10 | TRANSFORMER GRADLE | 15m | INSULATED CU CONDUCTOR 70mm ² |
| 11 | MV EARTH CONDUCTOR | 20m | 3/4.00mm STAY WIRE |
| 12 | POLE EARTH CONDUCTOR | 10 | |
| 13 | SADDLES | 3m | HOPE 50mm dia CLASS 6 |
| 14 | KICK PIPE | 2 | 3x32mm HOT DIP GALVANISED |
| 15 | STAPLES | 4 | 1.2m LONG - 16mm ϕ |
| 16 | EARTH SPIKE | 2 | |
| 17 | STAY INSULATOR | 2 | |
| 18 | POLE TOP MAKE OFF | 2 | |
| 19 | GUY GRIP | 2 | BS20 C/W THIMBLE |
| 20 | STAY ROD | 30m | 7/4.00 STAY WIRE GALVANISED |
| 21 | STAY WIRE GALVANISED | 2 | 450x450x6mm GALV. |
| 22 | BASE PLATE | 6x5m | SUPPLIED WITH TRF |
| 23 | JUMPERS | 3 | ALUMINIUM TO BRASS 70x16 |
| 24 | TRANSFORMER BUSHINGS | 3 | |
| 25 | TERMINATION LUGS | 1 | 11m LONG WITH TOP 220mm ϕ |
| 26 | WOODEN POLE | 1 | 9m LONG WITH TOP 220mm ϕ |
| 27 | WOODEN POLE | 1 | 50mm WIDE x 300mm LONG RED |
| 28 | DANGER PLATE | 1 | LETTERS ON WHITE |
| 29 | PHASE PLATE | 3 | |

NOTES:
 1. ALL FABRICATED ITEMS, BOLTS, NUTS AND WASHERS SHALL BE HOT DIPPED GALVANISED TO ASTM A153
 2. ALUMINIUM OXIDE GREASE SHALL BE USED ON ALL CLAMPS FOR CORROSION PROTECTION.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 MEDIUM VOLTAGE BARE OVERHEAD
 DISTRIBUTION: DISTRIBUTION TRANSFORMER
 STRUCTURE H-POLE MOUNTING
 -VILLAGE INTERNAL NETWORK-

| | | |
|-------------------------------------|---------------------|---------------------|
| DESIGNED: A.K | DRAWN: J.W.S | REV: 01-2001 |
| DRAWING No: STD-MVSD-33KV-01 | SCALE: N.T.S | |

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127115529+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127115529+02'00')
/CreationDate
(johnny)
/Author
-mark-