



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

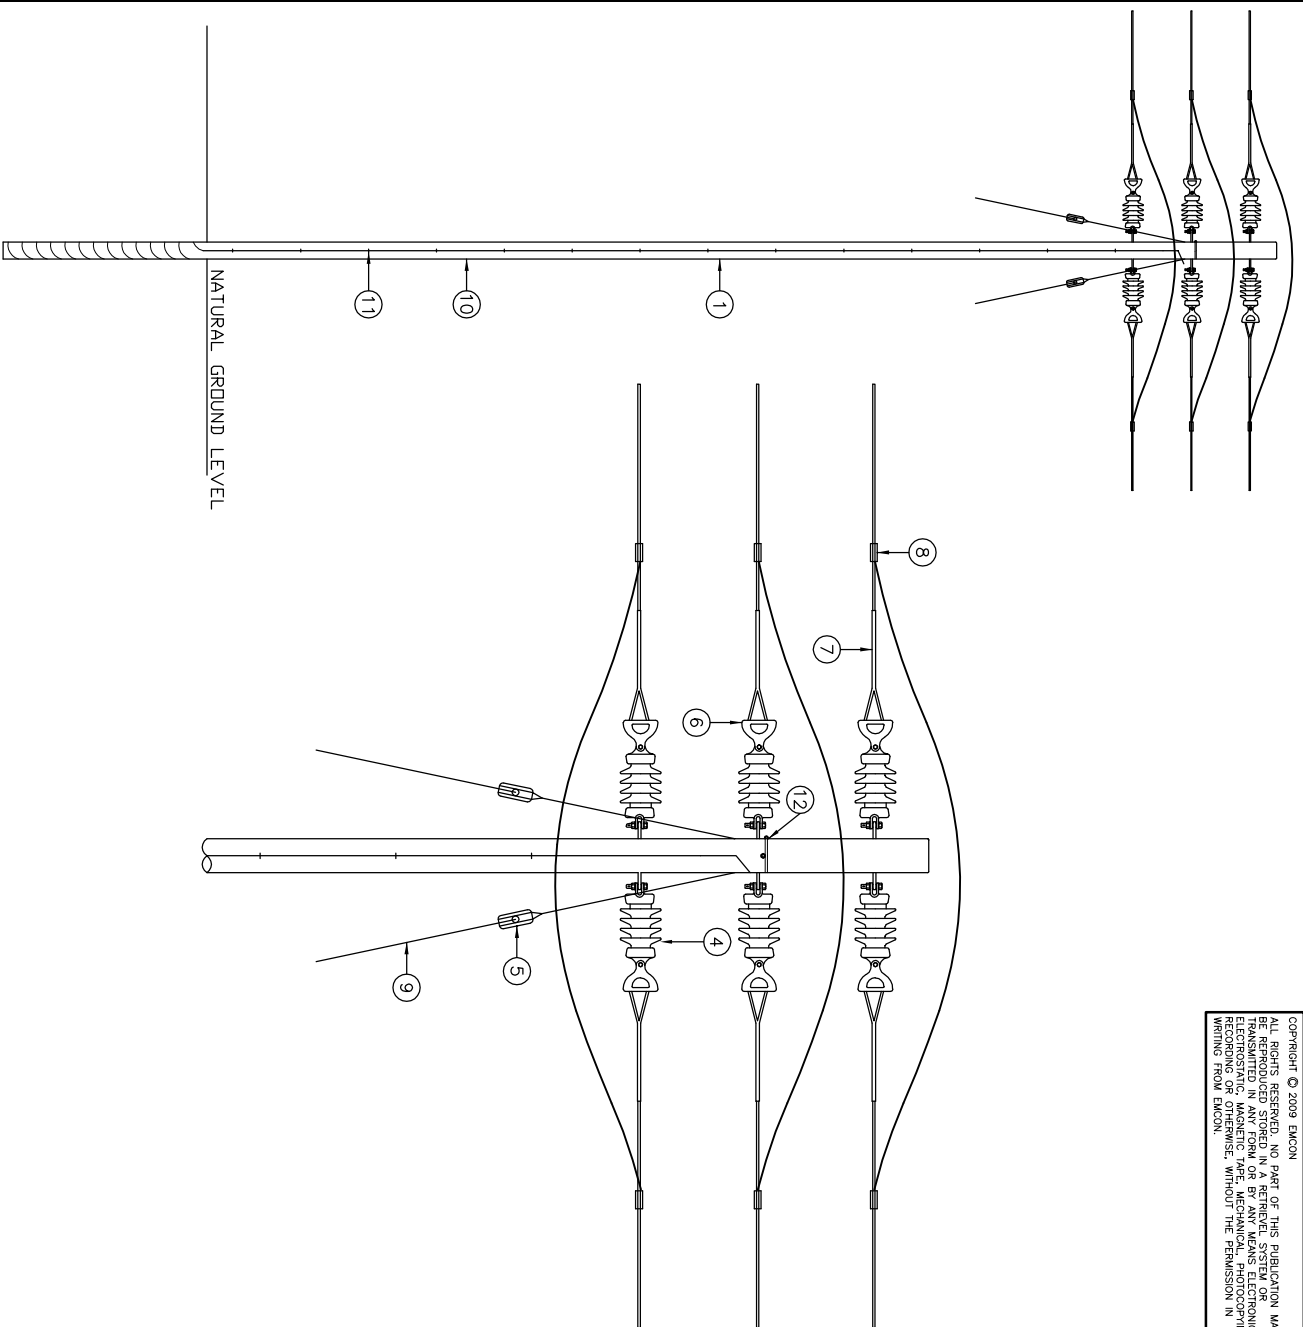

| ITEM | DESCRIPTION | QTY | REMARKS |
|------|----------------------|-----|---------------------------|
| 1 | WOODEN POLE | 1 | 11m LONG TOP 220mm ϕ |
| 2 | STAY INSULATOR | 2 | |
| 3 | THIMBLE CLEVIS | 2 | |
| 4 | LONGROD INSULATOR | 6 | EP 1044, 1200mm CREEPAGE |
| 5 | STAY INSULATOR | 2 | |
| 6 | THIMBLE CLEVIS | 6 | |
| 7 | DEAD END | 6 | |
| 8 | PG CLAMP | 6 | |
| 9 | NW STAY ASSEMBLY | 2 | SEE DWG NO. STD-MWF-08 |
| 10 | POLE EARTH CONDUCTOR | 11m | 3/4.00mm STAY WIRE |
| 11 | STAPLES | 40 | 3x32mm HOT DIP GALVANISED |
| 12 | BAND-IT STRAPPING | 1 | 20x0.7mm STAINLESS STEEL |

- NOTES:**
1. ALL FABRICATED ITEMS, BOLTS, NUTS AND WASHERS SHALL BE HOT DIPPED GALVANISED TO ASTM A153
 2. FOR TRANSFORMER RATED 25MVA.
 3. ALUMINIUM OXIDE GREASE SHALL BE USED ON ALL CLAMPS FOR CORROSION PROTECTION.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA

Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE

MEDIUM VOLTAGE BARE OVERHEAD
 DISTRIBUTION ANGLE POLE STRUCTURE,
 STAGGERED DELTA LINE
 --VILLAGE INTERNAL NETWORK--

| | | |
|-------------------------------------|---------------------|---------------------|
| DESIGNED: A.K | DRAWN: J.W.S | REV: 01-2001 |
| DRAWING No: STD-MVSD-33KV-07 | | SCALE: N.T.S |

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127115223+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127115223+02'00')
/CreationDate
(johnny)
/Author
-mark-