



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

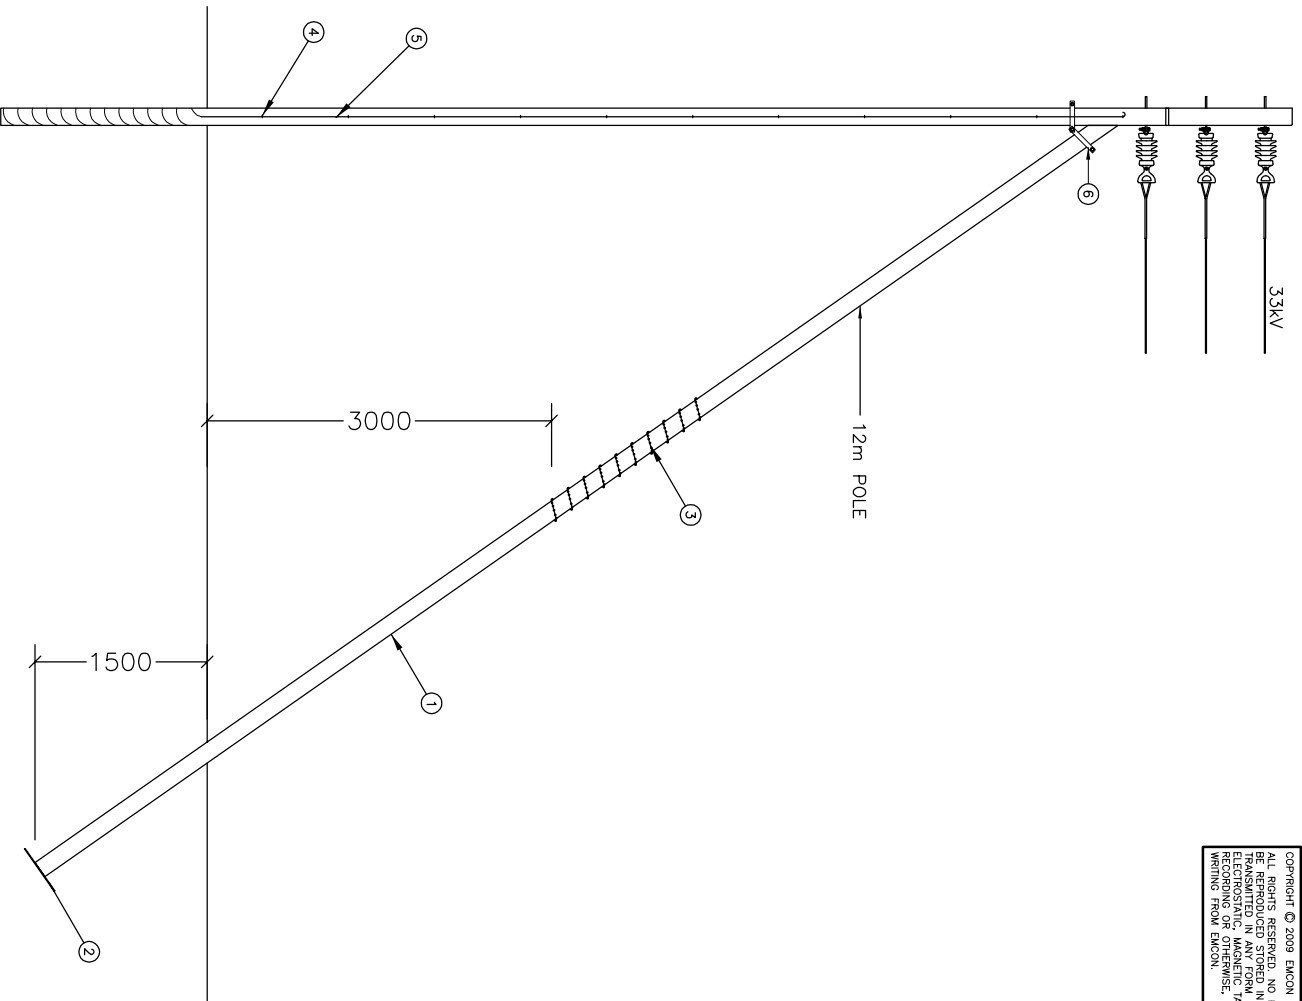

ITEM	DESCRIPTION	QTY	REMARKS
1	WOODEN STRUT POLE	1	12m LONG WITH TOP 220mm ϕ MIN
2	BASE PLATE	1	375x537x6mm GWS
3	BARBED WIRE	20m	3.25mm ϕ
4	STAPLES	30	3x32mm HOT DIPPED GALVANISED
5	POLE EARTH CONDUCTOR	18m	3/4.00mm HOT DIPPED GALV.
6	STRUT POLE BRACKETS	2	

NOTES:
 1. ONLY USED WHERE MV POLE STAY ASSEMBLY WILL NOT FIT OR AS INSTRUCTED.



ELECTRICITY CONTROL BOARD
 Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 MEDIUM VOLTAGE BARE OVERHEAD
 DISTRIBUTION STRUT POLE ASSEMBLY
 -VILLAGE INTERNAL NETWORK-

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MV/SD-33KV-16		SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127114953+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127114953+02'00')
/CreationDate
(johnny)
/Author
-mark-