



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

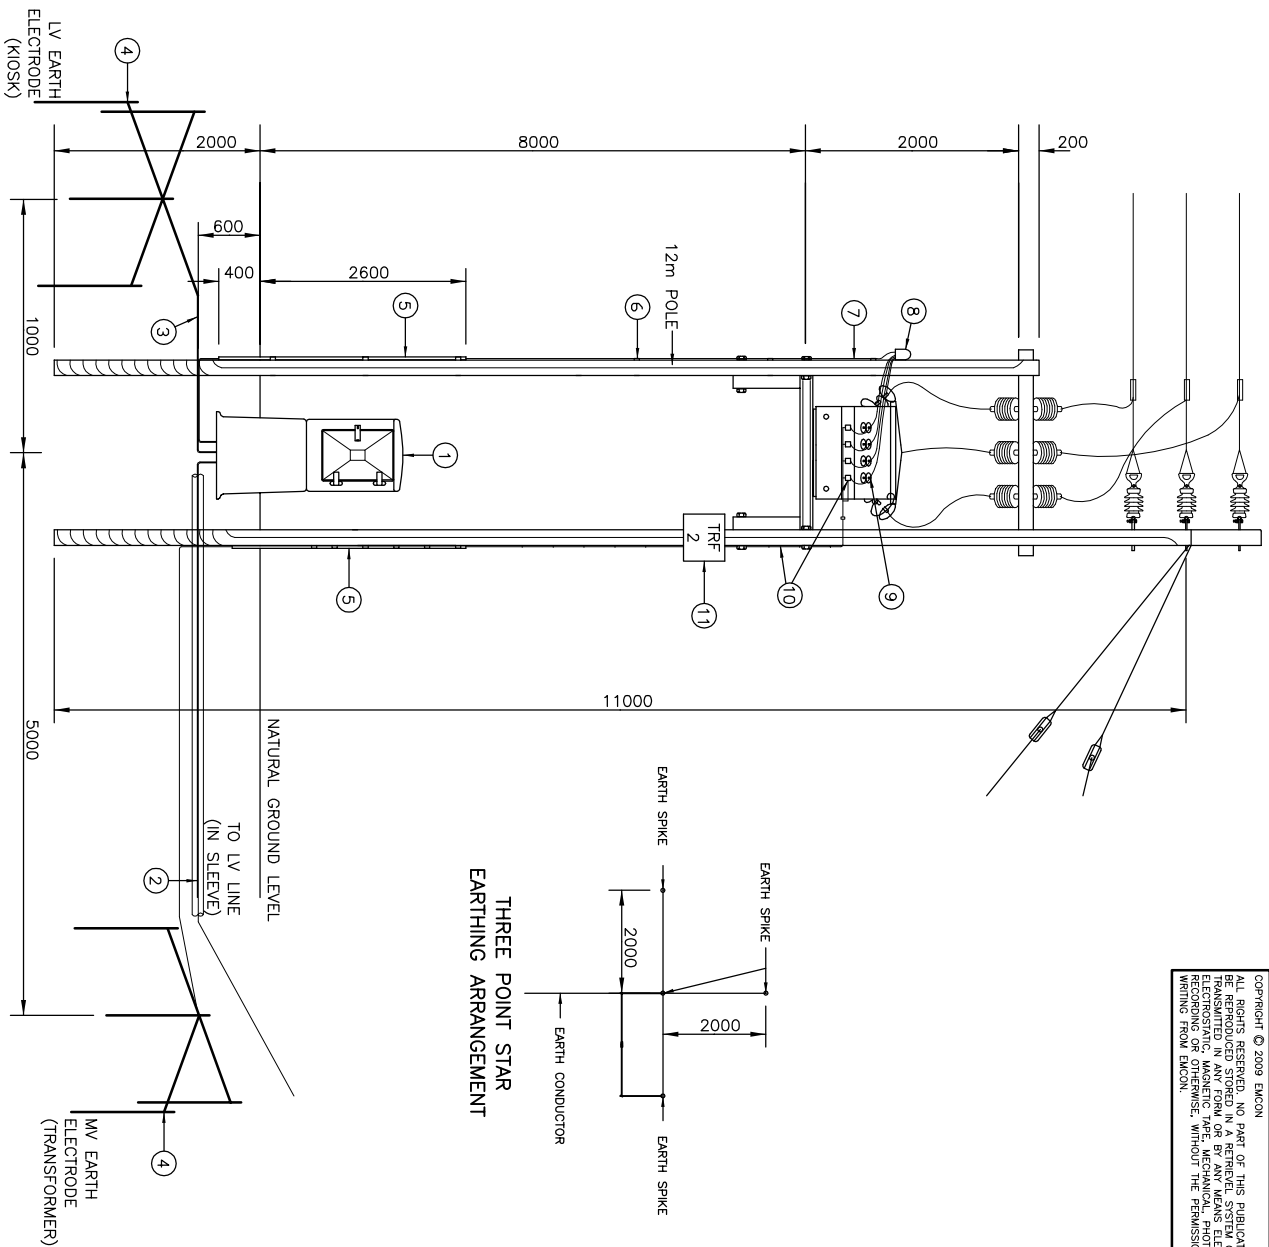

ITEM	DESCRIPTION	QTY	REMARKS
1	DISTRIBUTION KIOSK	1	SIZE AS SPECIFIED
2	SUPPLY TO LV LINE	-	BARE CU CONDUCTOR 70mm ²
3	KIOSK EARTH CONDUCTOR	4	1.2m LONG, 16mm ²
4	EARTH SPIKE	4	50mm ² HDPE
5	KICK PIPE	3m	TO SUIT CABLE AND KICK PIPE
6	GALVANISED SADDLES	9	SIZE AS SPECIFIED
7	CABLE	11m	POLE BOX
8	CABLE HOOD	1	SIZE AS REQUIRED
9	TERMINATION CRAMPING LUGS	8	ALREADY INSTALLED (INSULATED)
10	TRANSFORMER EARTH CONDUCTOR	-	
11	TRF NAME	1	

- NOTES:**
1. TRANSFORMER MV EARTH TO BE SEPARATE FROM KIOSK EARTH.
 2. LV SURGE ARRESTOR FROM LV NEUTRAL TO MV EARTH.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

**DISTRIBUTION TRANSFORMER CONNECTION
 LOCAL AUTHORITY
 -VILLAGE INTERNAL NETWORK-**

DRAWING TITLE

DESIGNED: A.K DRAWN: J.W.S REV: 01-2001
 DRAWING No: STD-MVSD-33KV-21 SCALE: N.T.S

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127114524+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127114524+02'00')
/CreationDate
(johnny)
/Author
-mark-