


COPYRIGHT © 2009 EMCON
 All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, electrostatic, magnetic tape, mechanical, photocopying, recording, or otherwise, without the permission in writing from EMCON.

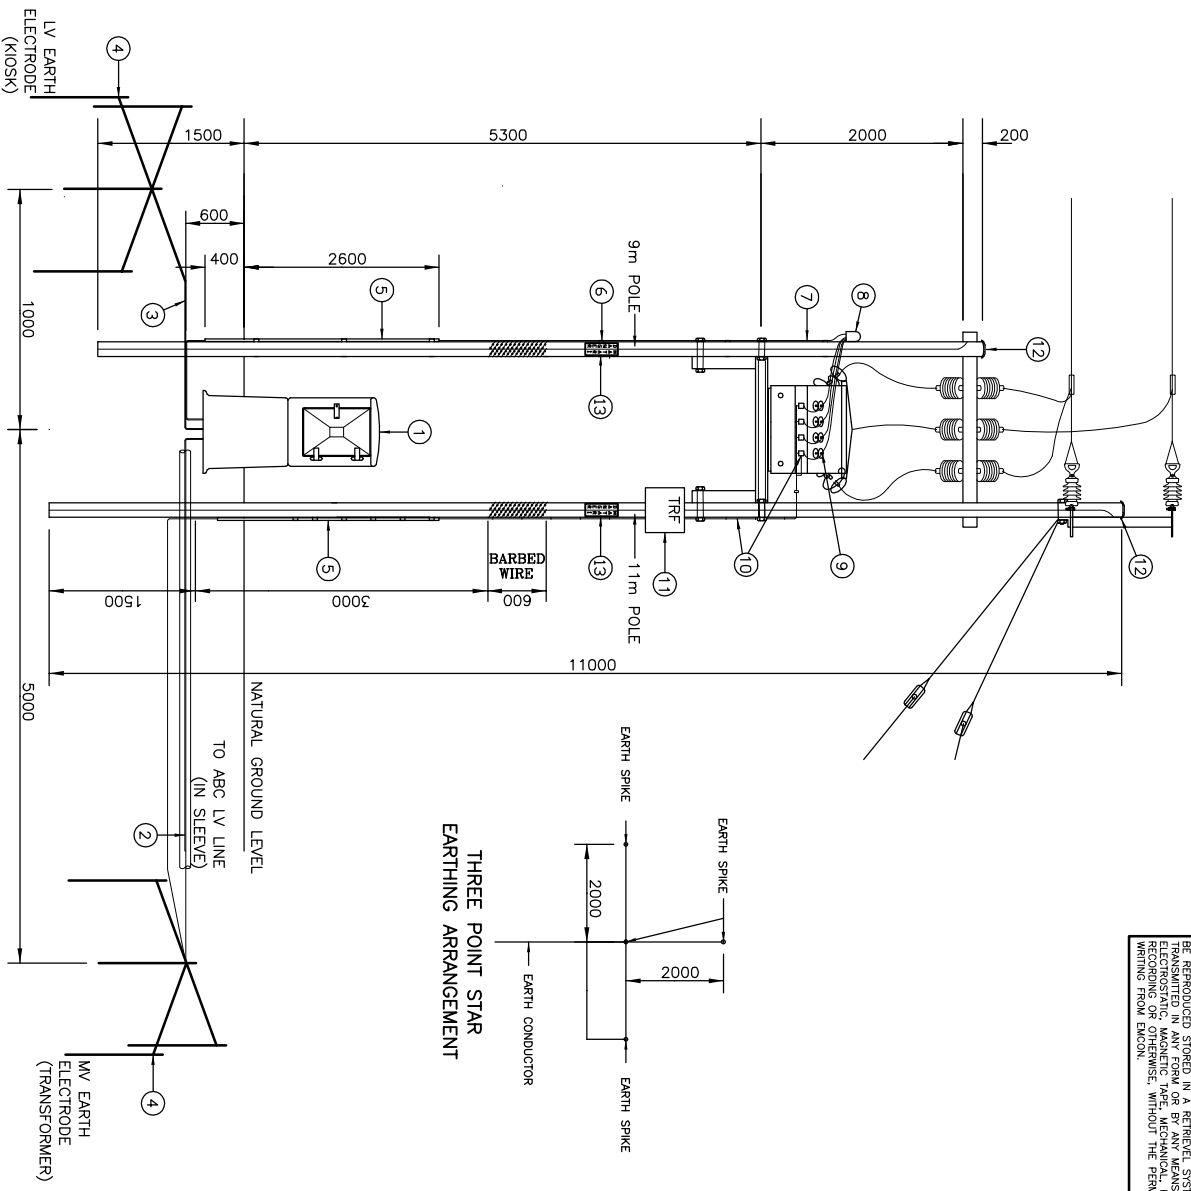


THREE POINT STAR
 EARTHING ARRANGEMENT

ITEM	DESCRIPTION	QTY	REMARKS
1	DISTRIBUTION KIOSK	1	SEE DRAWING NO STD-LVABC-20
2	SUPPLY TO ABC LINE	1	SIZE AS SPECIFIED
3	INSULATED EARTH CONDUCTOR	9m	BALE CO. CONDUCTOR 70mm ²
4	EARTH SPIKE	4x	12m LONG, 16mm ϕ
5	KICK PIPE	5m	50mm ϕ PIPE
6	GAUVANNED SAADDLES	9m	TO SUIT CABLE AND KICK PIPE
7	CABLE HOOD	11m	SIZE AS SPECIFIED
8	TERMINATION GRIPPING LUGS	8	SIZE AS REQUIRED
9	TRANSFORMER EARTH CONDUCTOR	1	ALREADY INSTALLED (INSULATED)
10	TRF	1	SEE DRAWING STD-LVABC-26
11	SIGN BOARD		
12	POLE CAP		
13	DANGER PLATE		

NOTES:

1. TRANSFORMER MV EARTH TO BE SEPARATE FROM KIOSK EARTH.
2. LV SURGE ARRESTOR FROM LV NEUTRAL TO MV EARTH.

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 LOW VOLTAGE AERIAL BUNDLE CONDUCTOR
 DISTRIBUTION SYSTEM
 DISTRIBUTION TRANSFORMER CONNECTION
 LOCAL AUTHORITY

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-MVAE-11KV-21	SCALE: N.T.S	

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127122605+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127122605+02'00')
/CreationDate
(johnny)
/Author
-mark-