



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY
 BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR
 TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC,
 ELECTROSTATIC, MAGNETIC TAPE, MECHANICAL, PHOTOCOPYING,
 RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN
 WRITING FROM EMCON.

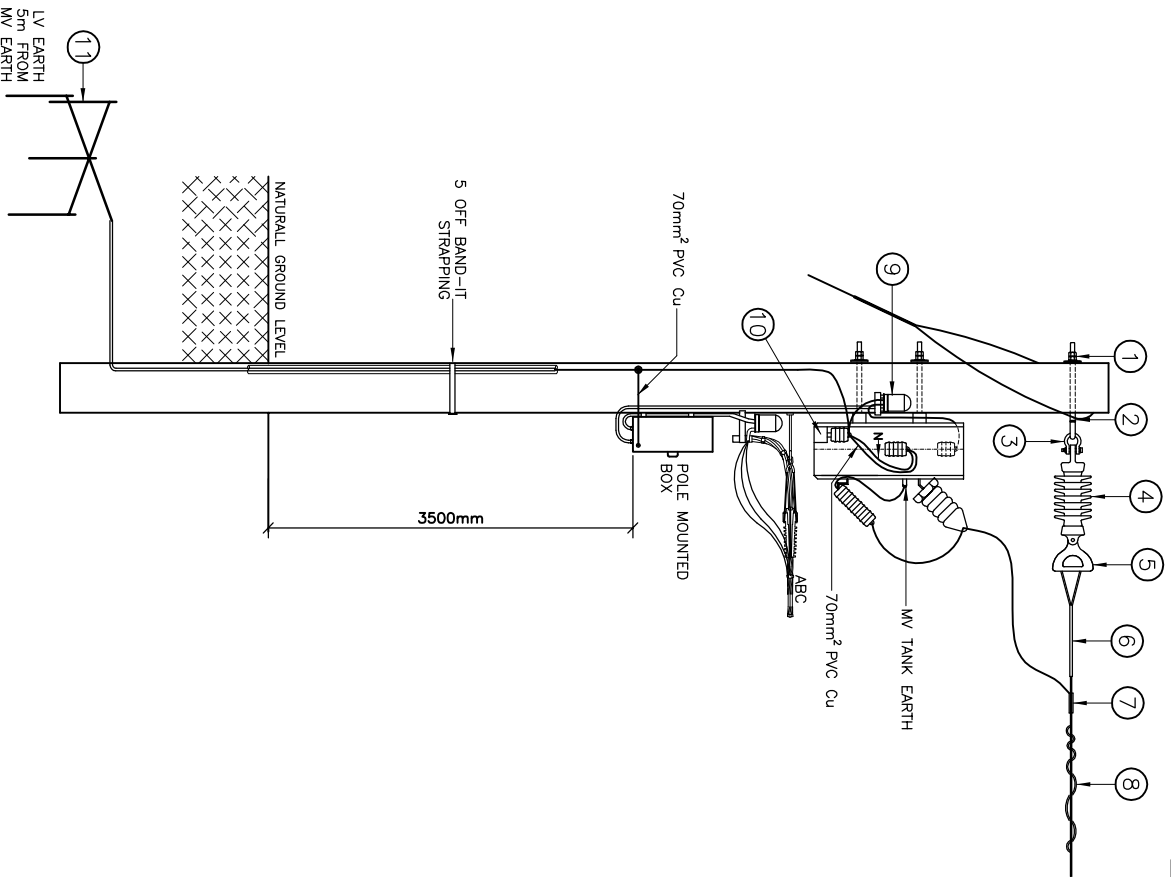

ITEM	DESCRIPTION	QTY	REMARKS
1	CURVED "C" WASHER & DOUBLE NUTS	1	VC37
2	254mm x 20mm EYE-BOLT COMPLETE	1	VC34
3	D-SCHACKLE	1	VC12
4	LONROD 33kV STRAIN INSULATOR	1	33kV ELBROC CAT NO. 810802
5	CLEVIS THIMBLE	1	PEP MITO70
6	DEAD END FOR MAGPIE	1	PEP DODE 250
7	3 BOLT PG CLAMPS (GOLD)	1	PEP 1646-3G
8	SPIRAL VIBRATION DAMPERS	1	PEP SVD34
9	CABLE HOOD	2	
10	LV SURGE ARRESTOR WITH BRACKET	1	
11	EARTH SPIKE	4	1.2m LONG, 16mm

NOTES:

ELECTRICITY CONTROL BOARD



Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

**SWER SYSTEM
 CONSUMER TRANSFORMER INSTALLATION**

DESIGNED: A.K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-SWER-12	SCALE: N.T.S	

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127143452+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127143452+02'00')
/CreationDate
(johnny)
/Author
-mark-