



COPYRIGHT © 2009 EMCON
 ALL RIGHTS RESERVED. NO PART OF THIS PUBLICATION MAY BE REPRODUCED STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE, WITHOUT THE PERMISSION IN WRITING FROM EMCON.

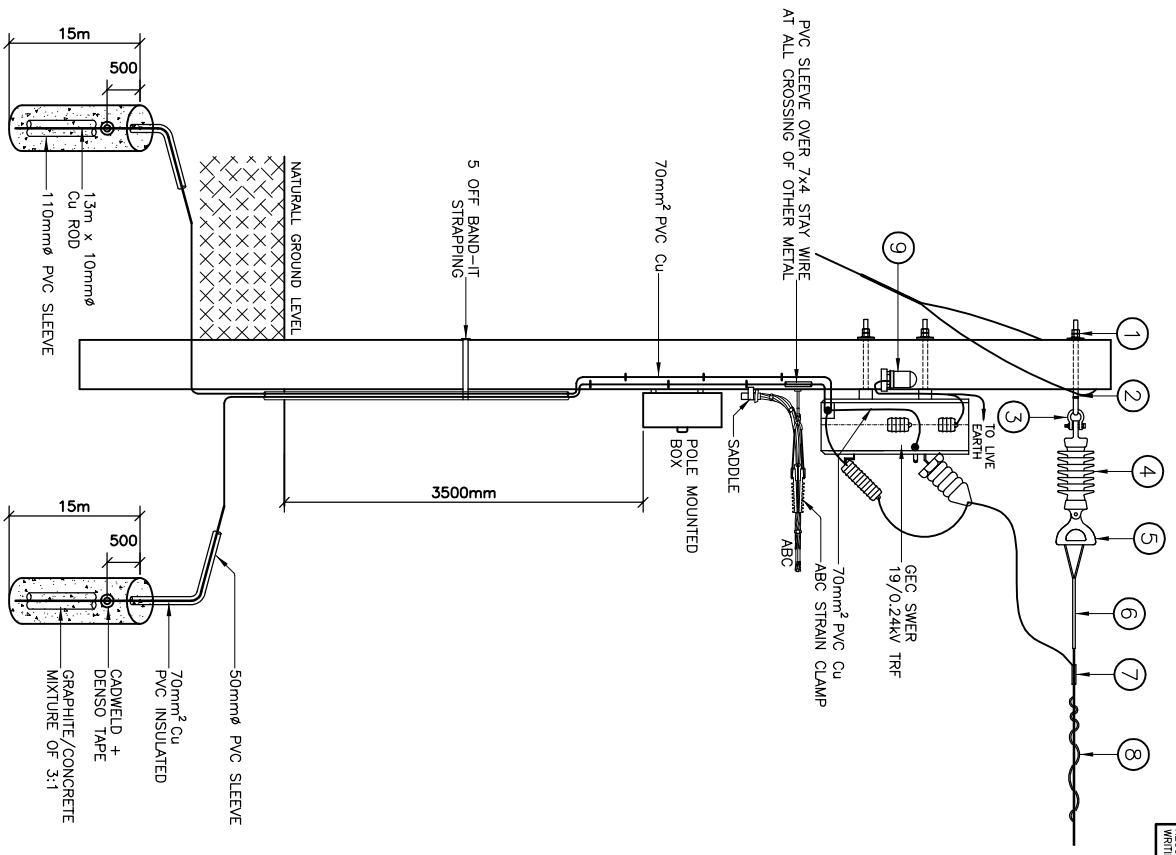

ITEM	DESCRIPTION	QTY	REMARKS
1	CURVED "C" WASHER & DOUBLE NUTS	1	VC37
2	254mm x 20mm EYE-BOLT COMPLETE	1	VC34
3	D-SCHACKLE	1	VC12
4	LONGROD 33kV STRAIN INSULATOR	1	33kV ELBROC CAT NO. 810802
5	OLENIS THIMBLE	1	PLE MTC70
6	DEAD END FOR MAGPIE	1	PLE DDE 250
7	3 BOLT FG CLAMPS (GOLD)	1	PLE 1646-3S
8	SPIRAL VIBRATION DAMPERS	1	PLE S0234
9	CABLE HOOD	2	

NOTES:

Blank area for notes.



ELECTRICITY CONTROL BOARD
 Box 2923
 Windhoek
 NAMIBIA
 Tel: (061) 374300
 Fax: (061) 374305

DRAWING TITLE
 SWER SYSTEM
 CONSUMER TRANSFORMER INSTALLATION

DESIGNED: A/K	DRAWN: J.W.S	REV: 01-2001
DRAWING No: STD-SWER-12A	SCALE: N.T.S	

ERROR: syntaxerror
OFFENDING COMMAND: --nostringval--

STACK:

/Title
()
/Subject
(D:20100127143334+02'00')
/ModDate
()
/Keywords
(PDFCreator Version 0.9.5)
/Creator
(D:20100127143334+02'00')
/CreationDate
(johnny)
/Author
-mark-